

#### **Engineering**

### **Technical Standard**

# TS 0502 – Authorised Products – Gravity Sewer and Pressure Pumping Main Systems

Version: 6.1

**Date**: 27 June 2023

Status: Final

Document ID: SAWS-ENG-0502

© 2022 SA Water Corporation. All rights reserved. This document may contain confidential information of SA Water Corporation. Disclosure or dissemination to unauthorised individuals is strictly prohibited. Uncontrolled when printed or downloaded.



# Copyright

This Standard is an intellectual property of the South Australian Water Corporation. It is copyright and all rights are reserved by SA Water. No part may be reproduced, copied or transmitted in any form or by any means without the express written permission of SA Water.

The information contained in this Standard is strictly for the private use of the intended recipient in relation to works or projects of SA Water.

This Standard has been prepared for SA Water's own internal use and SA Water makes no representation as to the quality, accuracy or suitability of the information for any other purpose.

### **Application & Interpretation of this Document**

It is the responsibility of the users of this Standard to ensure that the application of information is appropriate and that any designs based on this Standard are fit for SA Water's purposes and comply with all relevant Australian Standards, Acts and regulations.

Users of this Standard accept sole responsibility for interpretation and use of the information contained in this Standard. Users should independently verify the accuracy, fitness for purpose and application of information contained in this Standard.

Only the current revision of this Standard should be used which is available for download from the SA Water website.

### Significant/Major Changes Incorporated in This Edition

This Revision supersedes the previous version of TS 0502 Authorised Products – Gravity and Pressure Main Sewer Systems. Changes from Revision 6.0 include:

- **Clause 1.3.1** 
  - o AS 1646 and WSA 02 added.
- **Clause 3.1.2** 
  - Australian Standard added.
- **Clause 3.1.3** 
  - o Australian Standard added.
- **Clause 3.1.4** 
  - o Australian Standard added.
- **Clause 3.1.5** 
  - Australian Standard added.
- **Clause 3.1.6** 
  - o Note referencing Table 4.2 of WSA 02 and Australian Standard added.
- **Clause 3.1.7** 
  - Manufacturers added Advanced Piping Systems and Pipemakers Australia.
- **Clause 3.1.7** 
  - Manufacturers added Advanced Piping Systems and Vinidex
- Clause 3.3.1.1
  - o Notes updated.
- Clause 3.3.1.4.1
  - New Clause specifying authorised sealants.
- **Clause 5.4.1** 
  - Plastic bearers section updated.

# **Document Controls**

# **Revision History**

Revision	Date	Author	Comments
1.0	08/04/16	R Pearce	First TS Release – superseding the November 2014 edition of Authorised Items for Sewer Systems.
2.0	20/03/17	R Pearce	Numerous Clauses added/altered/updated, refer P. 2 - 4.
3.0	25/10/17	R Pearce	Clause 3.1.1 – U PVC pipe SN rating changed.
4.0	22/02/20	R Pearce	Numerous Clauses added/ altered/ updated – refer P. 2.
5.0	25/06/20	KT Claridge	Numerous Clauses added/ altered/ updated – refer P. 2.
5.1	27/10/21	KT Claridge	Numerous Clauses added/ altered/ updated – refer P. 2.
6.0	15/03/22	KT Claridge	Numerous Clauses added/ altered/ updated – refer P. 2.
6.1	27/06/23	KT Claridge	Numerous Clauses added/ altered/ updated – refer P. 2.

Template: Technical Standard Version 6.00, 10/05/2016

# **Approvers**

Role	Signature and Date
Responsible Discipline Lead	27/06/2023
Matthew Davis (for Kevin Claridge)	x Min
	Signer's Name
	Signed by: DA003681
Manager Engineering Quality and Innovation	27/06/2023
Matthew Davis	× Min
	Signer's Name
	Signed by: DA003681
Senior Manager Engineering Services	27/06/2023
Richard Gray	
	X Richard Gray
	Signer's Name
	Signed by: GR001964

### **Reviewers**

Role	Name	Revision	Review Date
Principal Engineer, Reticulation Networks	T Galek	4.0	01/03/19
Manager Engineering Quality and Innovation	M Davis	6.1	27/06/23

# **Contents**

1 In	troduction	7
1.1	Purpose	7
1.2	Glossary	7
1.3	References	8
1.3.1	Australian and International	8
1.3.2	SA Water Documents	9
1.4	Definitions	9
1.5	Disclaimer	10
2 Sc	cope	11
2.1	Safety in Design	11
3 N	on-Pressure (Gravity) Sewer	12
3.1	Pipes	12
3.1.1	Unplasticized Polyvinyl Chloride (U PVC), (DWV)	12
3.1.2	Polypropylene Pipe (Structured Wall) (PP)	12
3.1.3	Glass Filament Reinforced Thermosetting Plastic (GRP)	13
3.1.4	Reinforced Concrete Pipe	13
3.1.5	Mild Steel Polyurethane Lined Pipe (MSPL)	13
3.1.6	Ductile Iron Pipe (DI)	14
3.1.7	Polyethylene Pipe	14
3.2	Fittings	15
3.2.1	U PVC (DWV)	15
3.2.1.1	Reinforced Fittings	16
3.2.1.2	Standard Fittings	17
3.2.1.2	Standard Fittings (Cont'd)	18
3.2.1.3	Flexible Fittings	18
3.2.2	Polypropylene (Structured Wall) (PP)	19
3.3	Maintenance Structures	20
3.3.1	Precast Concrete Maintenance Holes	20
3.3.1.1	Concrete Shaft Increments	
3.3.1.2	Concrete Conversion Slabs	21
3.3.1.3	Concrete Adjustment Rings/Cover Slab	
3.3.1.4	Concrete Base	
3.3.1.4.		
3.3.1.5	Plastic Maintenance Holes	
3.3.1.6	Bearing/Support Ring	
3.3.1.7	Cone	
3.3.1.8	Chamber Riser Rings	
3.3.1.9	Standard Bases	
3.3.1.10		
3.3.2	Maintenance Shafts	
3.3.2.1	U PVC Shaft Bases	27

3.3.2.2	Polypropylene Rubber Ring Shaft Bases	27
3.3.2.3	Polyethylene Shaft Bases	28
3.3.2.4	Riser Shaft (U PVC)	28
3.3.2.5	Bends	29
3.3.2.5.	1 Vario Bends (U PVC)	29
3.3.2.5.	Polypropylene Bends	29
3.3.3	Inspection Opening/Inspection Point	30
3.3.3.1	Inspection Opening	30
3.3.3.1.	1 U PVC Pipes & Fittings	30
3.3.3.2	Inspection Point	30
3.3.3.2.	1 U PVC Pipes & Fittings	30
4 Pr	essure Pumping Main	31
4.1	Pipes	31
4.1.1	Oriented PVC (O PVC) & Modified PVC (M PVC)	31
4.1.2	Polyethylene Pipe	31
4.1.3	Mild Steel Polyurethane Lined Pipe	32
4.1.4	Ductile Iron Pipe (DI)	32
4.2	Fittings	33
4.2.1	Ductile Iron (FBE Coated)	33
4.2.2	Polyethylene Fittings	37
4.2.2.1	Flange / Flange with Thrust Ring & 80 Flange Fire Plug Offtake	37
4.2.2.2	Electrofusion Couplings	37
4.2.2.3	Electrofusion Puddle Flange	38
4.2.2.4	Butt Weld Fittings	38
4.3	Mains Couplings	38
4.3.1	Multi Fit Couplings	
4.3.1.1	Straight, Stepped & Adaptor Flange Couplings	
4.3.1.2	Gibaults	
4.4	Mains Tapping Fittings	
4.4.1	Ductile Iron (FBE Coated) Pre-Tapped Connectors	
4.4.2	Tapping Saddles - Low Pressure to Gravity Sewer	
4.4.3	Resilient Seat Gate Valve Double Flange	
4.4.4	Swing Check	
4.4.5	Fire Hydrant (For Air Bleed)	
4.4.6	Main Cock (For Air Bleed)	
4.5	Miscellaneous Fittings	
4.5.1	Camlock Couplings	41
5 C	overs	42
5.1	Maintenance Hole	42
5.1.1	Cast Iron Cover & Frame	
5.1.1.1	Trafficable	
5.1.1.2	Non Trafficable	
5.2	Maintenance Shaft	44

5.2.1	Cast Iron Cover & Frame	44
5.3	Inspection Opening	44
5.3.1	Cover & Support Items (Top Stones)	44
5.4	Inspection Point	45
5.4.1	Cover and Support Items (Top Stones)	45
5.5	Street Box / Heavy Duty (Type A)	46
5.5.1	Chamber, Lid and Concrete Support Spacer	46
6	Signs and Tape	47
6.1	Signs	47
6.2	Underground Warning Tape	47

### 1 Introduction

SA Water is responsible for operation and maintenance of an extensive amount of engineering infrastructure.

This standard has been developed to assist in the design, maintenance, construction, and management of this infrastructure. This Document lists technically conforming products approved for installation within SA Water's infrastructure networks.

The products listed have been approved after their evaluation based upon the SA Water product appraisal procedure.

Approved products shall only be obtained from the listed manufacturer or their authorised agent.

### 1.1 Purpose

The purpose of this standard is to detail minimum requirements to ensure that assets covered by the scope of this standard are constructed and maintained to consistent standards and attain the required asset life.

This document provides confirmation of products SA Water has authorised, based on their technical merits. Design Consultants and Construction Contractors should use the information presented within this document for confirmation of products SA Water has authorised for use.

Product Manufacturers, suppliers and other stakeholders may also use the information as reference material.

SA Water personnel should source items from the Store. If not stocked, they should procure by means of:

- utilising the relevant SA Water Period Contract or Standing Offer Arrangement,
- where an item is not covered under a Contract or Standing Offer Arrangement, contacting a relevant Stores or Procurement Officer.

### 1.2 Glossary

The following glossary items are used in this document:

Term	Description
DIPL	Ductile Iron Polyurethane Lined Pipe
DN	Diameter Nominal
DWV	Drain, Waste, Vent
FBE	Fusion Bonded Epoxy
GRP	Glass Filament Reinforced Thermosetting Plastic
MSPL	Mild Steel Polyurethane Lined Pipe
PE	Polyethylene Pipe
PIPA	Plastic Industry Pipe Association
PP	Polypropylene Pipe
PVC	Polyvinyl Chloride
PVC M	Modified PVC
PVC O	Oriented PVC
RRJ	Rubber Ring Joint

SA Water	South Australian Water Corporation
SCL	Steel Cement Lined Pipe
TG	SA Water Technical Guideline
TS	SA Water Technical Standard
U PVC	Unplasticized Polyvinyl Chloride
WSCM	Water Supply Construction Manual

### 1.3 References

# 1.3.1 Australian and International

The following table identifies Australian and International standards and other similar documents referenced in this document:

Number	Title
AS 1281	Cement mortar lining of steel pipes and fittings
AS 1302	Steel reinforcing bars for concrete
AS 1303	Steel reinforcing wire for concrete
AS 1304	Welded wire reinforcing
AS 1379	The specification and manufacture of concrete
AS 1646	Elastomeric seals for waterworks purposes
AS 1579	Arc-welded steel pipes and fittings for water and wastewater
AS 2419.2	Fire Hydrant Valves
AS 2758.1	Aggregates and rock for engineering purposes - concrete aggregates
AS 3571	Glass filament reinforced thermosetting plastics (GRP) pipes - polyester based - Water supply, sewerage and drainage applications
AS 3600	Concrete structures
AS 3735	Concrete structures for retaining liquids
AS 3972	General purpose and blended cements
AS 3996	Access covers and grates
AS 4198	Precast concrete access chambers for sewerage applications
AS 4321	Fusion - bonded medium density polyethylene coating and lining for pipes and fittings
AS 4794	Non-return valves - Swing check and tilting disc
AS/NZS 1260	PVC pipes and fittings for drain, waste and vent (DWV) applications
AS/NZS 2032	Code of practice for the installation of PVC pipe systems
AS/NZS 2280	Ductile iron pipes and fittings
AS/NZS 2638-2	Gate valves for water works purposes
AS/NZS 2648.1	Underground marking tape - non-detectable tape
AS/NZS 3725	Design for installation of buried concrete pipes
AS/NZS 4058	Precast concrete pipes (pressure and non-pressure)
AS/NZS 4129	Fittings for polyethylene pipe for pressure applications
AS/NZS 4130	Polyethylene (PE) pipes for pressure applications

AS/NZS 4158	Thermal-bonded polymeric coatings on valves and fittings for water industry purposes
AS/NZS 4441	Oriented PVC (PVC-O) pipes for pressure applications
AS/NZS 4765	Modified PVC (PVC-M) pipes for pressure applications
AS/NZS 4999	PVC - U maintenance shafts
AS/NZS 5065	Polyethylene and polypropylene pipes and fittings for drainage and sewerage applications
WSA 100 - 2002	Industry standard for PVC - U Maintenance shafts
WSA 137	Water Industry Standard for Maintenance Shafts and Chambers for Sewerage
WSA PS 260	Gate valves - resilient seated
WSA PS 264	Non-return (reflux) valves
WSA PS 270	Mechanical couplings, unrestrained
WSA PS 318	Marking tape, detectable
WSA PS 319	Marking tape, non-detectable
WSAA 02	Gravity Sewerage Code of Australia

### 1.3.2 SA Water Documents

The following table identifies the SA Water standards and other similar documents referenced in this document:

Number	Title
TS 0101	Safety in Design
TS 0503	Authorised Products for Water Systems
TS 0710	Concrete

### 1.4 Definitions

The following definitions are applicable to this document:

Term	Description
SA Water's Representative	The SA Water representative with delegated authority under a Contract or engagement, including (as applicable):  • Superintendent's Representative (e.g. AS 4300 & AS 2124 etc.)  • SA Water Project Manager  • SA Water Construction Technical Officer/Manager  • SA Water nominated contact person
Responsible Discipline Lead	The engineering discipline expert responsible for TS 0502 defined on page 3 (via SA Water's Representative)
Constructor	The organisation responsible for constructing and installing infrastructure for SA Water whether it be a third party under contract to SA Water or an in-house entity.
Designer	The organisation responsible for designing infrastructure for SA Water whether it be a third party under contract to SA Water or a Constructor, or an in-house entity

### 1.5 Disclaimer

- SA Water reserves the right to alter, amend or withdraw this document, at any time, without prior notice.
- SA Water does not give preference to any particular make or type of product listed herein. Manufacturers are presented in alphabetical order, not in any order of preference.
- All products listed may be subject to change by the manufacturer. In such circumstances
  manufacturers are required to notify SA Water of any changes in the design, materials or
  manufacturing process of any approved product. SA Water is reliant upon manufacturers
  providing such notification in a timely manner and takes no responsibility for any issue that
  may arise should a manufacturer fail to do so.
- It is the responsibility of the Designer/ Constructor to ensure selected products are appropriate for the intended application.
- It is the responsibility of the Designer/ Constructor to ensure the product complies with the infrastructure category and meets the relevant Australian standards.
- It is the responsibility of the Constructor to ensure components do not exceed any expiry date.
- Product sizing may vary between manufacturers. Size range provided herein is a guide only and the Designer/ Constructor shall refer to the manufacturer for the product size and availability.
- Pipe and fitting sizing have been limited to DN 300 throughout this document. Larger sizes are available from the manufacturer. However, consideration of any product not itemised herein is subject to SA Water approval.
- Information within this document is correct at time of publication E&OE. The date of
  publication of this document can be found on the front page, and, in the left-hand corner
  of the footer on each subsequent page.

# 2 Scope

This document specifies products that are authorised for use in the following sewer systems:

- Gravity Sewer Systems up to a maximum size of DN 300.
- Pressure Pumping Mains up to a maximum size of DN 200.

Should a development project contain any product of diameter larger than stated above, specific approval from SA Water will be required for the works to be undertaken by means of the Developer Agreement.

The developer's Consultant or Contractor shall provide the SA Water Representative with data sheets/ manufacturer information for all products larger than stated above.

SA Water will review the information provided and advice regarding the suitability of the product.

### 2.1 Safety in Design

SA Water is committed providing safe workplaces for our people and safe services for our customers.

In keeping with this commitment, and to ensure the Supplier/Manufacturer has satisfied their legislated duties, the Supplier/Manufacturer shall provide information in accordance with the Work Health and Safety Act 2012 (SA) part 2 division 3, section 25. This may take the form of Operation and Maintenance manuals and/or SiD Hazard Registers (as specified by TS 0101).

Designers that utilise products contained in this Standard shall apply SA Water Technical Standard TS 0101 to incorporate the information provided by the Supplier/Manufacturer in the development of their design/s and transfer this to relevant parties.

# Non-Pressure (Gravity) Sewer

# 3.1 Pipes

# 3.1.1 Unplasticized Polyvinyl Chloride (U PVC), (DWV)

Shall comply with the following Standard	AS/NZS 1260 AS/NZS 2032		
Notes:	DN 100 = SN 10 DN 150 - 300 = SN 8 Solvent weld pipes only Refer to Clause 3.2 for fittings authorised for use with U PVC pipe. Other products may be considered for a specific installation. For such circumstance, specific approval is required from the SA Water Representative. Construction of DWV pipes and fitting, shall be undertaken in compliance with PIPA document POP 102 (Solvent Cement Welding of PVC Pipe)	DN 100 - 300	
Manufacturers	Iplex Pipelines Pipe King Pipemakers		
	Viadux Vinidex		

# 3.1.2 Polypropylene Pipe (Structured Wall) (PP)

Shall comply with the following Standard	AS/NZS 5065 AS 1646	
Notes:	One rubber ring per joint is required – placed in the first or second trough nearest the leading edge of the pipe spigot (refer manufacturer's requirements)  Where two or more consecutive ribs are broken, the section of damaged pipe shall be replaced.  All cuts in Polypropylene structured wall pipe are to be made in the centre of two consecutive ribs.  All fittings shall be obtained from the same pipe manufacturer	DN 150 - 300
Manufacturers	Iplex	SewerMAX
	Vinidex	SewerPRO

# 3.1.3 Glass Filament Reinforced Thermosetting Plastic (GRP)

Shall comply with the following Standard	AS 3571 AS 1646	
Notes:	Use of GRP pipe shall be approved by the SA Water representative. Generally, RRJ (Rubber Ring Joint) pipe used. Fittings shall be obtained from the same pipe Manufacturer.	DN 150 - 300
Manufacturers	Fibrelogic	Flowtite

### 3.1.4 Reinforced Concrete Pipe

Shall comply with the following Standard	AS/NZS 3725 AS 3735 AS/NZS 4058 AS 1646		
Notes:	Concrete for pipe manufacture shall be calcareous aggregate only.	DN 150 - 300	
Manufacturers	CSR Humes		
	Civilmart		

# 3.1.5 Mild Steel Polyurethane Lined Pipe (MSPL)

Shall comply with the following Standard	AS 1579 AS 4321 AS 1646	
Notes:	Use of MSPL pipe shall be approved by the SA Water representative.	DN 300
Manufacturers	Viadux	

# 3.1.6 Ductile Iron Pipe (DI)

Shall comply with the following Standard	AS/NZS 2280 AS 3680 AS 3681 AS 1646	
Notes:	Use of DI external coated pipe shall be approved by the SA Water representative. Polyethylene sleeving shall be used with these pipes for corrosion protection, (coloured CREAM). For cementitious linings, refer Table 4.2 of WSA 02.	DN 300
Manufacturers	Von Roll (Polyurethane Lined)	Ecopur
	St Gobain PAM (Calcium Aluminate Lined)	TYTON Integral
	Viadux (Sulphate resisting cement mortar)	TYTON X Range

# 3.1.7 Polyethylene Pipe

Shall comply with the following Standard/s	AS/NZS 4130	
Tollowing Standard/s	AS/NZS 2032	
Notes:	Approval for use of PE for a gravity system shall be sought from the SA Water representative.	
	PE100 and PN 16 minimum	
	All pipes shall be coloured:	
	BLACK with CREAM stripes or All CREAM.	
	PE fittings – refer Clause 4.2.2.	OD 125 - 250
	PE fittings, e.g. connection to U PVC fittings, shall be confirmed and approved by the SA Water representative.	OD 125 - 250
Manufacturers	Australian Custom Pipes	
	Cromford Pipe	Identipipe
	David Moss Group	
	DM Plastic	Goldline
	Enviropipe	Enviropressure
	Iplex Pipelines	POLIplex
	Vinidex	
	Advanced Piping Systems	Maxiplast Polyethylene - PE100 - Acu-Pipe
	Pipemakers Australia	PE100

Size of PE Pipe Equivalent

Standard Pipe Size	PE Pipe Equivalent
DN 100	OD 125
DN 150	OD 180
DN 225	OD 250

Note: Diameters larger than OD 250 require specific SA Water approval.

# 3.2 Fittings

# 3.2.1 U PVC (DWV)

Shall comply with the following Standard	AS/NZS 1260 AS/NZS 2032
Notes:	Only solvent weld joint fittings authorised for use.  All Fittings shall be compliant with AS/NZS 1260  Standard Fittings are generally rated SN 6.  Reinforced Fittings have been strengthened.  All Reinforced Fittings shall be approved by SA Water.  Suitable techniques for reinforcement may be either:  an injection moulded fitting manufactured with an increased wall thickness, or,  a standard fitting which has been enhanced by the application of layers of fibreglass wrapping and bracing.  For each category refer Manufacturer regarding availability.  Refer SCM for approved use of each category.

### 3.2.1.1 Reinforced Fittings

Plain Bend (F-F)	Plain Bend (F-F, M-F)	Angled Junction (F-F, M-F)	Reducing Junction (F-F, M-F)
DN 100 & 150	DN 100 & 150	DN 100 & 150	DN 150/150/100
90°	45°	45°	45°
Manufacturers			
Plastec	Plastec	Plastec	Plastec
Holman	Holman	Holman	Holman

Inspection Tee	Eccentric Taper		
DN 100 & 150	DN 150 x 100	DN 100 & 150	
90°		Drop Bend	
	Manufacture	ers	
Plastec	Plastec	Plastec	
Holman	Holman		

#### Notes:

- 1. Reinforced fittings displayed in sizing DN 100 and DN 150 only.
- 2. Fabrication in larger diameter or 'special orders' may be possible. Refer Manufacturer for confirmation of availability.
- 3. Reinforced fittings are not categorised in AS/NZS 1260. Approval of reinforced fittings is subject to individual product assessment by SA Water.

### 3.2.1.2 Standard Fittings

Bend (F-F, M-F)	Plain Bend (F-F, M-F)	Angled Junction (F-F, M-F)	Reducing Junction (F-F, M-F)
DN 225 & 300	DN 225 & 300	DN 225 & 300	DN 225 & 300
90°	45°	45°	45°
	Manufac	turers	
Aymroo			Aymroo
Iplex Pipelines	Iplex Pipelines	Iplex Pipelines	Iplex Pipelines
Pipe King		Pipe King	Pipe King
Plastec	Plastec	Plastec	Plastec
Vinidex	Vinidex	Vinidex	Vinidex
Holman	Holman	Holman	Holman

Eccentric Taper	Straight Coupling Threaded	Threaded Cap	Glue On Cap	
DN 225 & 300	DN 100 & 150	DN 100 & 150	DN 100 - 300	
	Manufacturers			
Aymroo			Aymroo	
Iplex Pipelines	Iplex Pipelines	Iplex Pipelines	Iplex Pipelines	
	Pipe King	Pipe King	Pipe King	
Plastec	Plastec	Plastec	Plastec	
Vinidex	Vinidex	Vinidex	Vinidex	
Holman	Holman	Holman	Holman	

### 3.2.1.2 Standard Fittings (Cont'd)


Slip Coupling	Drop Bend	Riser Junction	
DN 100 – 150	DN 100 - 225	DN 225 & 300	
Manufacture		s	
	Aymroo	Aymroo	
Iplex Pipelines			
Plastec	Plastec		
Vinidex			
Holman	Holman	Holman	

#### **Flexible Fittings** 3.2.1.3



# 3.2.2 Polypropylene (Structured Wall) (PP)

Plain Bend	Tee 'T' Junction	Angled Junction &	
		Reducing Junction	
DN 150 - 300	DN 150 - 300	DN 150 - 300	
45° - 90°	88° - 90°	45°	
Manufacturers			
Iplex Pipelines	Iplex Pipelines	Iplex Pipelines	
Vinidex	Vinidex	Vinidex	

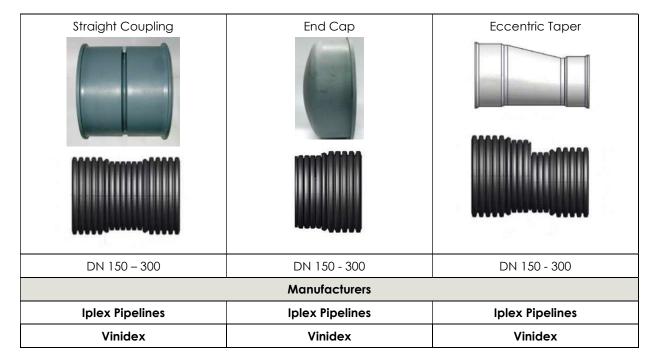

#### Note:

Ends available to accept Polypropylene, PVC Solvent Weld Joint & Vitrified Clay.

### 3.3 Maintenance Structures

### 3.3.1 Precast Concrete Maintenance Holes

Shall comply with the	TS 0600	A	\S 1379	
following Standards	TS 0710		S 2758.1	
	AS 1302		\S 3600	
	AS 1303		S 3996	
	AS 1304		S 4198	
Assembly	7.6.76			
Specification				
.,			CI Cove	
			CI COVE	
	0		CI Fro	ama
				ing
				Riser Slab
				Control Clab
		9	2 -	— Conversion Slab
		4		— Joint Sealant
		F		- Shaft Increment
		-		
				1 1 6 1 1
		7		- Joint Sealant
		-		
		-	-	×
		-		
			[-]	- Shaft Sections
		-	[-]	Sharr Sections
		-	[-]	
		in the	-	
		-	-	
	_	-	-	- Joint Sealant
	12	31		SUPPLIES PROSESSOR
		[*		
	r	(a-		
		~[-	1.1-1	D
		- 1		Base
			)	
		1, 1, 1, 1, 1, 1, 1, 1, 1, 1, 1, 1, 1, 1		
	Ì			
		Typical Precast	Maintenance Hole	
		DN 900/10	)50/1200/1500	
		21. 700, 100		

#### 3.3.1.1 Concrete Shaft Increments

Notes:	Sizing availability to be confirmed with Manufacturer.  Joint details shall be selected and installed in accordance with SA Water Standard Drawing Number 4005-20005-03.  Authorised sealants are listed in clause 3.3.1.4.1	DN 900, 1050, 1200 & 1500 Available in Heights 300 - 1350		
	Manufacturers			
	Civilmart	Humes		


### 3.3.1.2 Concrete Conversion Slabs

Combination Conversion Slab 1050	Conversion Slab 1200	Conversion Slab 1500 (Rectangular)	
DN 1050	DN 1200 (Access available in eccentric or central position)	DN 1500	
Manufacturers			
Bianco Precast	Bianco Precast	Bianco Precast	
Civilmart	Civilmart	Civilmart	

### 3.3.1.3 Concrete Adjustment Rings/Cover Slab

Shaft Increment Height Adjusting Ring	Riser Slab (Butt Increment)
DN 1050 & 1200 Thickness 25 - 150	DN 1050 & 1200
Manuf	acturers
Bianco Precast	Bianco Precast
Civilmart	Civilmart

#### 3.3.1.4 Concrete Base

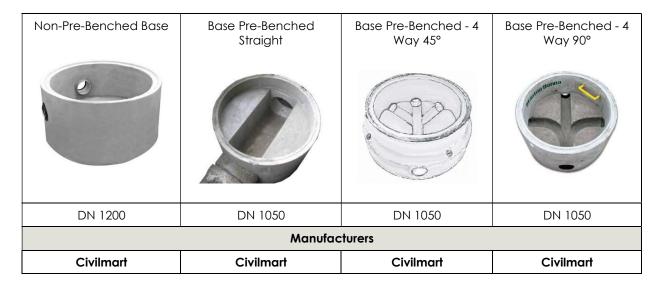


Refer Clause 5.1.1 for Maintenance Hole Covers

#### 3.3.1.4.1 Authorised Sealants

Manufacturers	Product References
Henkel FERROPRE	Two pack epoxy resin bonding sealer
Vivacity Engineering	Megapoxy P1 - Part A and B

#### **Plastic Maintenance Holes** 3.3.1.5

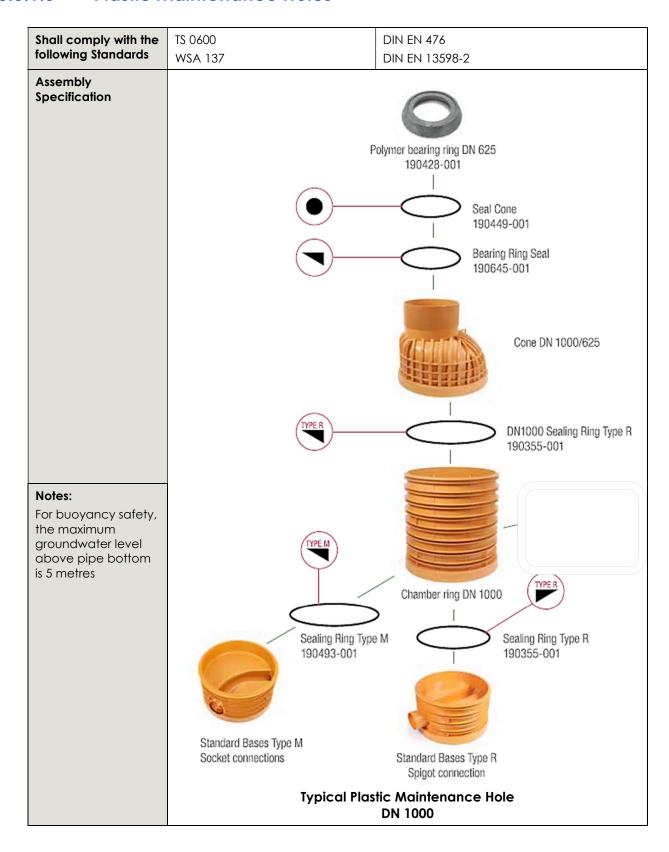

#### **Bearing/Support Ring** 3.3.1.6

Shall comply with the following Standard	WSA 137 (2019) DIN EN 476 DIN EN 13598-2.		
Notes:	Sizing availability to be confirmed with manufacturer		
		Polymer Ring	Concrete Ring
Manufacturer			
		Rehau	lplex

#### 3.3.1.7 Cone

following Standard Notes:	DIN EN 476 DIN EN 13598-2.  Sizing availability to be confirmed with Manufacturer		DN600 SBR Rubber Ring Seal PP Reducing Conc DN1000 (BM600
Manufacturer			
		Rehau	lplex

#### **Chamber Riser Rings** 3.3.1.8

Shall comply with the following Standard	WSA 137 (2019) DIN EN 476 DIN EN 13598-2.		DN1000 SBR Rubber Ring Seal  DN1000 Corrupated PP Ricer
Notes:	Sizing availability to be confirmed with Manufacturer		DN1000 SBR Rubber Reng Soul
	Manufacturer		
		Rehau	lplex

#### **Standard Bases** 3.3.1.9

Shall comply with the following Standard	WSA 137 (2019) DIN EN 476 DIN EN 13598-2.		DN1000 PP Base
Notes:	Sizing availability to be confirmed with Manufacturer		SBR Seal encapsulated in Gwivel Gosket
Manufacturer			
		Rehau	lplex

#### Riser Connection – for PVC and PP 3.3.1.10


Shall comply with the following Standard	WSA 137 (2019) DIN EN 476 DIN EN 13598-2.		PVC DWV Coupling RRJ PVC DWV pipe
Notes:	Sizing availability to be confirmed with Manufacturer		PVC DWV Drop pipe
		Manufacturer	
		Rehau	lplex

### 3.3.2 Maintenance Shafts

Shall comply with the following Standard

AS/NZS 4999 WSA 137

# Assembly Specification

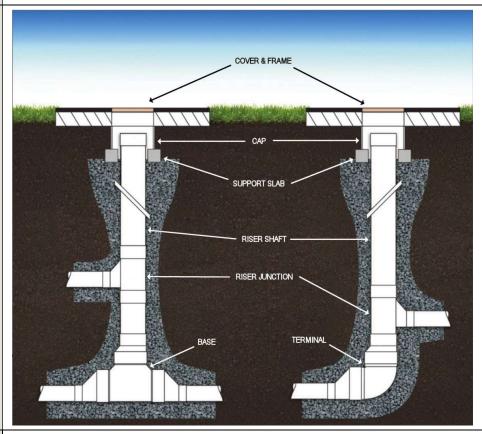

#### Notes:

Manufacturers have differing restrictions on the depth for use of their Maintenance Shafts

Refer Clause <u>5.2.1</u> for Maintenance Shaft Covers

Refer to Clause  $\underline{3.1.1}$  &  $\underline{3.1.2}$  For connecting pipes.

The Riser shaft shall be U PVC and shall include a combination of components from 3.1.1 and 3.2.1

#### Maximum invert shall be:

- Aymroo 5 metres
- SMS 4 metres
- Rehau 4 metres.
- Smartstream 5 metres
- Iplex 5 metres


### 3.3.2.1 U PVC Shaft Bases


Terminal	Straight	45° Junction
DN 150 & 225 90°	DN 150, 225 & 300	DN 150 x 150 x 150 225 x 225 x 150 300 x 300 x 300
Manufacturer		
Aymroo	Aymroo	Aymroo

45° Corner	15°, 22.5°, 30°, 45° & 90°	CAMS (Central Access MS)	
DN 300	DN 150 & 225	DN 150 & 225	
	Manufacturer		
Aymroo	Aymroo	Aymroo	


# 3.3.2.2 Polypropylene Rubber Ring Shaft Bases



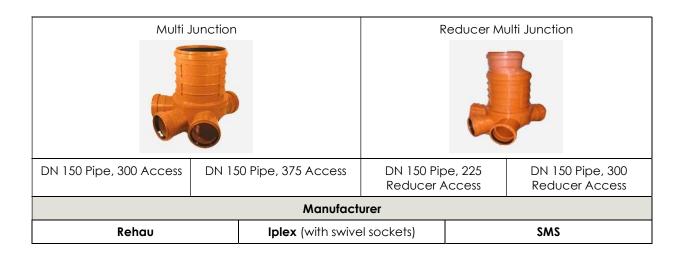

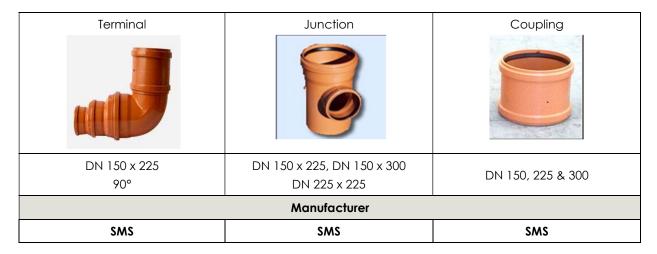

### 3.3.2.3 Polyethylene Shaft Bases

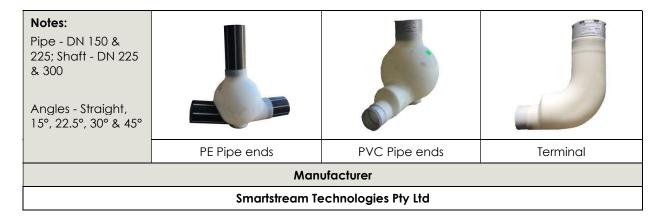


### 3.3.2.4 Riser Shaft (U PVC)

Refer to the following Clauses for authorised pipe and fittings:


Authorised Pipe: 3.1.1Authorised Fittings: 3.2.1

### 3.3.2.5 Bends

### 3.3.2.5.1 Vario Bends (U PVC)

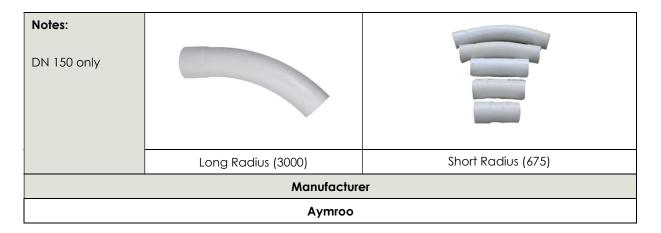


### 3.3.2.5.2 Polypropylene Bends

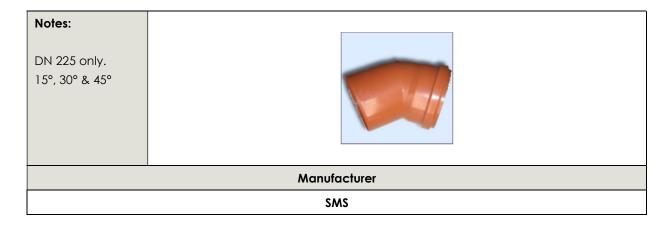

Page 30 of 47

### 3.3.3 Inspection Opening/Inspection Point

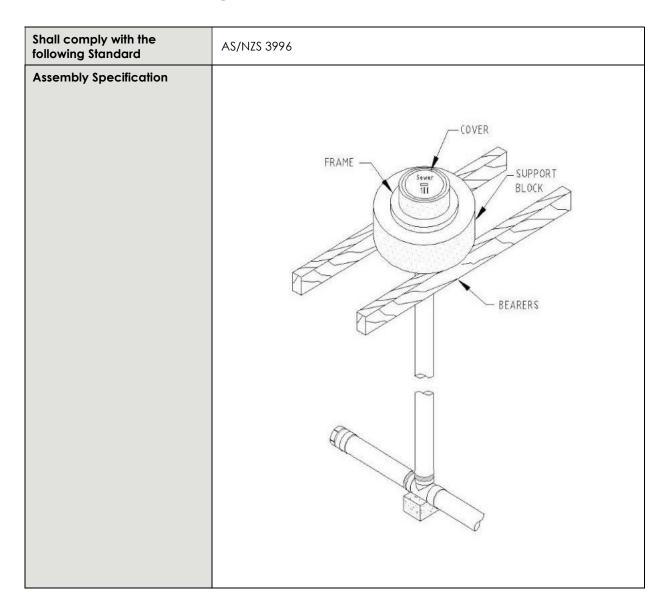

### 3.3.3.1 Inspection Opening

#### 3.3.3.1.1 U PVC Pipes & Fittings

- Refer Clause 3.1.1 for authorised Pipe (DN 150 ONLY)
- Refer Clause 3.2.1 for authorised Fittings (DN 150 ONLY)
- Refer Clause 5.3.1 for Inspection Opening Covers

#### 3.3.3.2 Inspection Point

#### 3.3.3.2.1 U PVC Pipes & Fittings

- Refer Clause 3.1.1 for authorised Pipe (DN 100 & 150 ONLY)
- Refer Clause 3.2.1 for authorised Fittings (DN 100 & 150 ONLY)
- Refer to Clause 5.4.1 for Inspection Point Covers

# **Pressure Pumping Main**

# 4.1 Pipes

# 4.1.1 Oriented PVC (O PVC) & Modified PVC (M PVC)

Shall comply with the following Standards	AS/NZS 4441 AS/NZS 4765		
Notes:	All pipes shall be CREAM c	colour	
	All pipes and fittings shall be Rubber Ring Jointed. All fittings are to be Ductile Iron FBE		
	coated. PN 16 Series 2 unless others	wise specified	DN 100 - 200
		· .	
Manufacturers	David Moss Group	PVC M	
	Iplex Pipelines	PVC M	Blue Rhino
		PVC O	Apollo Blue
	Micron Pipelines	PVC M	
	Micron ripelines	PVC O	
	Viadux	PVC M	Tuf-Flo
	Vinidex	PVC M	Hydro Blue
		PVC O	Supermain

### 4.1.2 Polyethylene Pipe

Shall comply with the following Standard	AS/NZS 4130 AS/NZS 2032	
Notes:	PE100 and PN 16 minimum  All pipes shall be: BLACK with CREAM stripe or all CREAM in colour	OD 125 - 250
Manufacturers		Refer Clause 3.1.7

# 4.1.3 Mild Steel Polyurethane Lined Pipe

Shall comply with the following Standards	AS 1281 AS 1579 AS 4321	
Notes:		
		DN 100 - 200
Manufacturers		Refer Clause 3.1.5

# 4.1.4 Ductile Iron Pipe (DI)


Shall comply with the following Standards	AS 3680 AS 3681 AS/NZS 2280	
Notes:	Polyethylene sleeving shall be used for corrosion protection coloured CREAM	DN 100 - 200
Manufacturers		Refer Clause 3.1.6

# 4.2 Fittings

# 4.2.1 Ductile Iron (FBE Coated)

Shall comply with the following Standards	AS/NZS 2280 AS 4087
Notes:	Series 2, PN 16 unless specified otherwise
	BLACK or BLUE coloured fittings are acceptable for use in Pressure Sewer Systems.
	Sizing for Ductile Iron fittings up to DN 200.
	Refer TS 0503, for complete Range of Ductile Iron (FBE Coated) Fittings, together with manufacturer, notes and specifications.

### Tee "T"

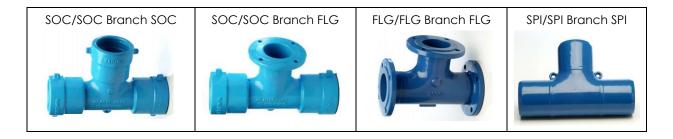

### **Bends**



### **Connectors**



### Reducer/Taper



# **Hydrant Tee "T"**



### **Supported Bends**



# Flanged Extension Pipe (Flanged Connector)



# Cap




# **Flanges**




# **Eccentric Reducer Flange / Flange**



### **Tee Scour**

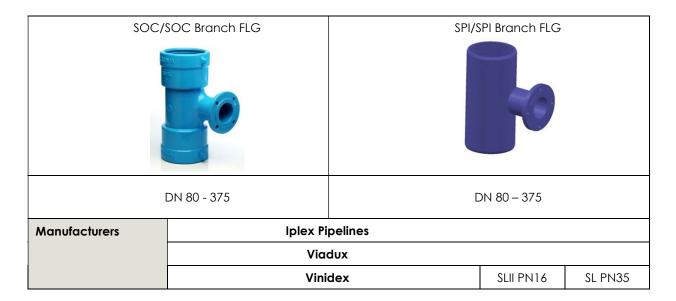

# Flange Flared Fittings

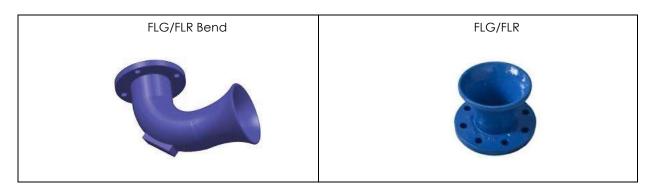

### **4.2.2** Polyethylene Fittings

Shall comply with the following Standard	AS/NZS 4129	
Notes:	Only PE products: <ul> <li>Identified in SA Water documents, and</li> <li>Obtained from one of the listed Manufacturers, or their Agent, are approved for use.</li> </ul>	
	Pipe sizing shall be confirmed with the SA Water Representative.	
	Approved jointing methods shall be Electrofusion or Butt Weld.	
	Butt welding shall only be permitted by welders authorised by SA Water. For details refer:	
	<ul><li>Factory welding- TS 0503, 9.1.1.</li><li>Site welding - TS 0503, 9.1.2.</li></ul>	
	Electrofusion Welding shall only be permitted by qualified welders.	
	Required qualification is PMBWELD302B – Electrofusion Weld.	
	Fabrication and deliverables shall be in accordance with WSCM Standard Drawings	

### 4.2.2.1 Flange / Flange with Thrust Ring & 80 Flange Fire Plug Offtake



### 4.2.2.2 Electrofusion Couplings

Shall comply with the following Standard	AS/NZS 4129	
Notes:	Only specific SDR11 Electrofusion fittings are approved.	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications.	

### 4.2.2.3 Electrofusion Puddle Flange



Refer TS 0503, Clause 4.2.3 for manufacturer, notes and specifications.

### 4.2.2.4 Butt Weld Fittings


Shall comply with the following Standard	AS/NZS 4129
Notes: Only specific SDR11 spigot fittings are approved.	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications

# 4.3 Mains Couplings

# 4.3.1 Multi Fit Couplings

Shall comply with the following Standards	AS/NZS 4158 WSA PS 270
Notes:	Grade 316 stainless steel bolts having a life expectancy of over 50 years.
	Not to be used on polyethylene pipes.
	Bitumen coated end clips shall not be used.

### 4.3.1.1 Straight, Stepped & Adaptor Flange Couplings

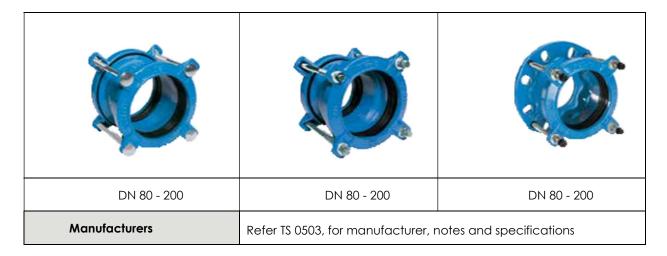

#### **4.3.1.2 Gibaults**



# **4.4 Mains Tapping Fittings**

### 4.4.1 Ductile Iron (FBE Coated) Pre-Tapped Connectors

Shall comply with the following Standards	AS/NZS 4158 WSA PS 201	
Notes:	Single Tapping Each Side.  DN 100 x (20 – 50BSP)  DN 150 x (20 – 50BSP)  DN 200 x (50BSP)	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	

# 4.4.2 Tapping Saddles - Low Pressure to Gravity Sewer

For tapping saddles approved for low pressure connections to gravity sewer, refer TS 0503 -Clause 5.2.1

### 4.4.3 Resilient Seat Gate Valve Double Flange

Shall comply with the following Standards	AS/NZS 2638-2 WSA PS 260	<u> </u>
Notes:	1.6MPa (PN 16) unless otherwise specified Clockwise Closing Not for Buried Applications DN 80 - 200	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	

### 4.4.4 Swing Check

Shall comply with the following Standards	AS 4794 WSA PS 264	25 A A AA
Notes:	1.6MPa (PN 16) unless otherwise specified. With Extended Spindle & Counterweight Not for Buried Applications DN 80 - 200	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	

### 4.4.5 Fire Hydrant (For Air Bleed)

Shall comply with the following Standards	AS 2419.2	
Notes:	DN 80	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	

# 4.4.6 Main Cock (For Air Bleed)

Shall Comply with the following Standard	AS 3688	
Notes:	Tube DN 20	
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	

# 4.5 Miscellaneous Fittings

# 4.5.1 Camlock Couplings

Shall comply with the following Standards	AS 2638 WSA PS 262	
Notes:	Metal or Polyethylene Coupling (Type F) with BSP male thread Dust Cap (Type DC)	
		DN 50 - 100
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	


### Covers

### 5.1 Maintenance Hole

### 5.1.1 Cast Iron Cover & Frame

Shall Comply with the following Standard	AS/NZS 3996 (2019)	
Notes:	All trafficable covers shall comply with AS/NZS 3996 Class D. In compliance with AS/NZS 3996 (2019), when installed on freeways/motorways, Class E shall be used.	
	Non-Trafficable covers shall comply with AS/NZS 3996 Class B.	
	Cover to be marked SEWER	
	Concrete Riser Slab/Conversion Slab is required to adjust to the required height of Maintenance Hole.	
	Hinged covers shall only be installed, with the hinge facing oncoming traffic.	
	For Cover Supports Slabs refer 3.3.1.2 Concrete Conversion Slabs.	

#### 5.1.1.1 Trafficable

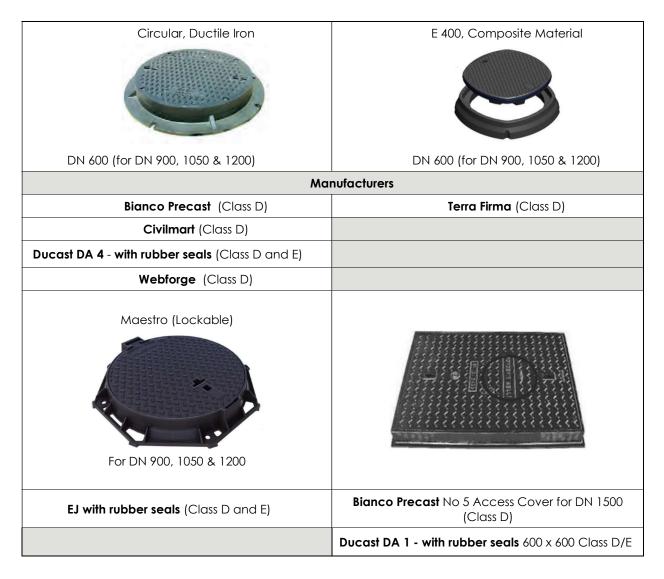

### 5.1.1.2 Non Trafficable




### 5.2 Maintenance Shaft

### 5.2.1 Cast Iron Cover & Frame

Notes:	The one-piece lid shall be used for Maintenance Shafts.  Cover shall be marked SEWER.	
Half Height	Trafficable Cover Support Slab	Non-Trafficable Cover Support Ring
	1200 x 800 x 170	600 x 140 Thick
Manufacturers	Refer TS 0503, for manufacturer, notes and specifications	

# **5.3 Inspection Opening**

### 5.3.1 Cover & Support Items (Top Stones)

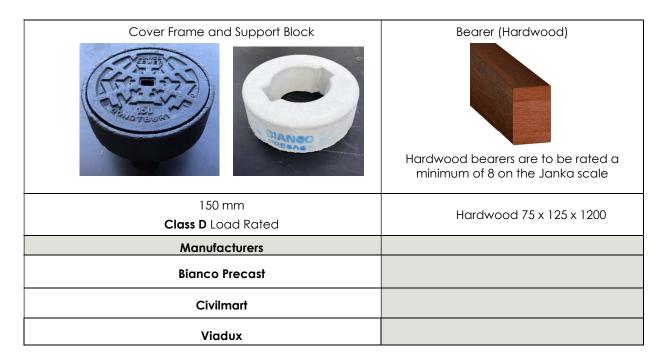

# **5.4 Inspection Point**

# 5.4.1 Cover and Support Items (Top Stones)

Cover Frame and Support Block	Cover Frame and Support Block	Bearer (Hardwood or Recycled Plastic)
SEWER SINGE	GLASS TO	Hardwood bearers are to be rated a minimum of 8 on the Janka scale
100 mm  Class B Load Rated  Manufa	150 mm  Class D Load Rated	Hardwood 75 x 125 x 1800 Plastic 50 x 75 x 1800 Plastic 45 x 90 x 1800 Plastic 40 x 70 x 1200 Plastic 45 x 75 x 1200
Bianco Precast	Bianco Precast	
Civilmart	Civilmart	
Viadux	Viadux	

# 5.5 Street Box / Heavy Duty (Type A)

### 5.5.1 Chamber, Lid and Concrete Support Spacer



# Signs and Tape

# 6.1 Signs

Specification	SA Water - WSCM Drawing	
Notes:	For use on: Sewer Pump-Out Branch Sewer Stop Valve Sewer Air Valve	SA WATER A STOP VALVE
Manufacturers	Peninsula Casting	
Manufacturers	Ferretti International	

# **6.2 Underground Warning Tape**

	Viadux	
	Tapex	
	Romac Trading	
Manufacturers	Heatech	
Notes:	When used for Sewer Pumping Mains Underground - Non-Detectable	A SEASEK FINE
Specification	'CAUTION BURIED SEWER MAIN BELOW' – Detectable tape required	CAUTION C
Shall Comply with the following Standard	AS/NZS 2648.1 WSA PS 318 WSA PS 319	